


Testexport

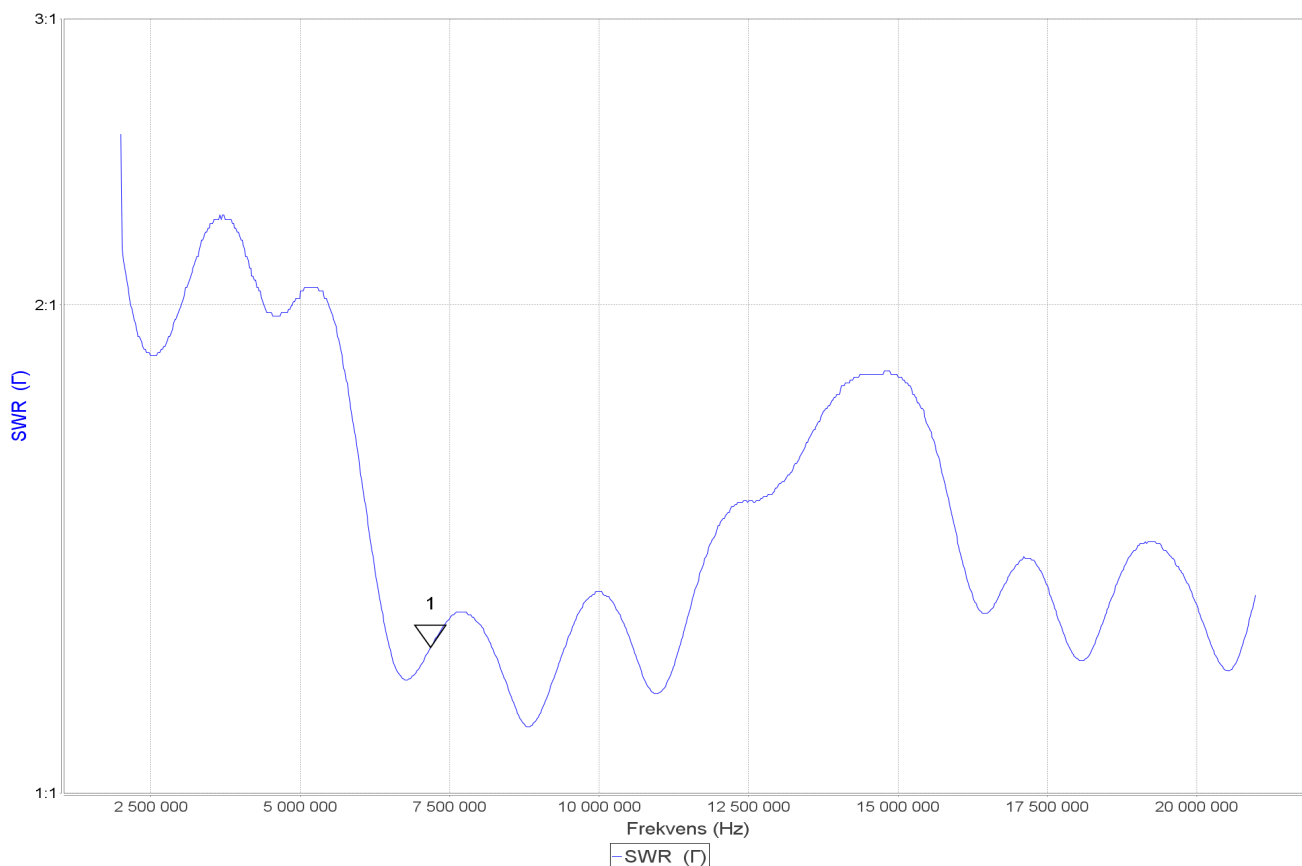

Markör	Frekvens	RL (dB)	RP (°)	Z (Ω)	Rs (Ω)	Xs (Ω)	Theta	SWR
1	7 179 922	-19,77	30,79	59,7	59,3	6,3	6,1	1,23:1

Kommentar:

Date: 2023-10-29 08:40
Mode: Reflektion
Analyser: MetroVNA / IZ7LDG - MetroVNA
Scan
Start: 2000000 / 2 000 000
Stop: 20999872 / 20 999 872
Samples: 928
Overscan: 1
Calibration
Samples: 2000
Overscan: 0
File: ---
User: goranl
Headline: Testexport
Port extension len: <not set>m
Port extension vf: <not set>

